

Series TY-L — 5.6 and 8.0 K-factor Upright and Pendent Intermediate Level Sprinklers Standard Response

General Description

The Series TY-L, 5.6 and 8.0 K-factor Upright and Pendent Intermediate Level Sprinklers described in this data sheet are automatic sprinklers of the “standard response” solder type. They are “standard spray” sprinklers intended for use in fire sprinkler systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency (e.g., UL Listing is based on NFPA requirements). Both the Pendent and Upright Sprinklers produce a hemispherical water distribution pattern below the deflector.

Intermediate Level Sprinklers are primarily designed for use in rack storage sprinkler systems where their thermally sensitive elements must be shielded from the water spray of higher elevation sprinklers that could operate earlier during a fire. Intermediate Level Sprinklers are also used in other applications such as beneath open gridded catwalks.

NOTICE

The Series TY-L Sprinklers described herein must be installed and maintained in compliance with this document, as well as with the applicable standards of the National Fire Protection Association, in addition to the standards of any other authorities having jurisdiction. Failure to do so may impair the performance of these devices.

IMPORTANT

Always refer to Technical Data Sheet TFP700 for the “INSTALLER WARNING” that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. Contact the installing contractor or product manufacturer with any questions.

Sprinkler Identification Number (SIN)

TY3113 – Upright 5.6K, 1/2”NPT

TY3211 – Pendent 5.6K, 1/2”NPT

TY4113 – Upright 8.0K, 3/4”NPT

TY4211 – Pendent 8.0K, 3/4”NPT

TY3113 is a redesignation for S1809 and G3253

TY3211 is a redesignation for S1801 and G3112

TY4113 is a redesignation for S1822 and G3153

TY4211 is a redesignation for S1811 and G3102

Technical Data

Approvals

UL and C-UL Listed

FM Approved

(Refer to Table A for complete approval information including corrosion resistant status.)

Maximum Working Pressure

175 psi (12,1 bar)

Discharge Coefficient

K = 5.6 gpm/psi^{1/2} (80,6 lpm/bar^{1/2})

K = 8.0 gpm/psi^{1/2} (115,2 lpm/bar^{1/2})

Temperature Ratings

Refer to Table A



Finishes

Natural Brass



Physical Characteristics

Frame	Brass
Sealing Button	Bronze w/TEFLON
Ejection Spring	Stainless Steel
Strut	MONEL
Hook	Bronze/MONEL
Deflector	Bronze
Shield	Brass
Fusible Element	Solder, Copper, Stainless Steel

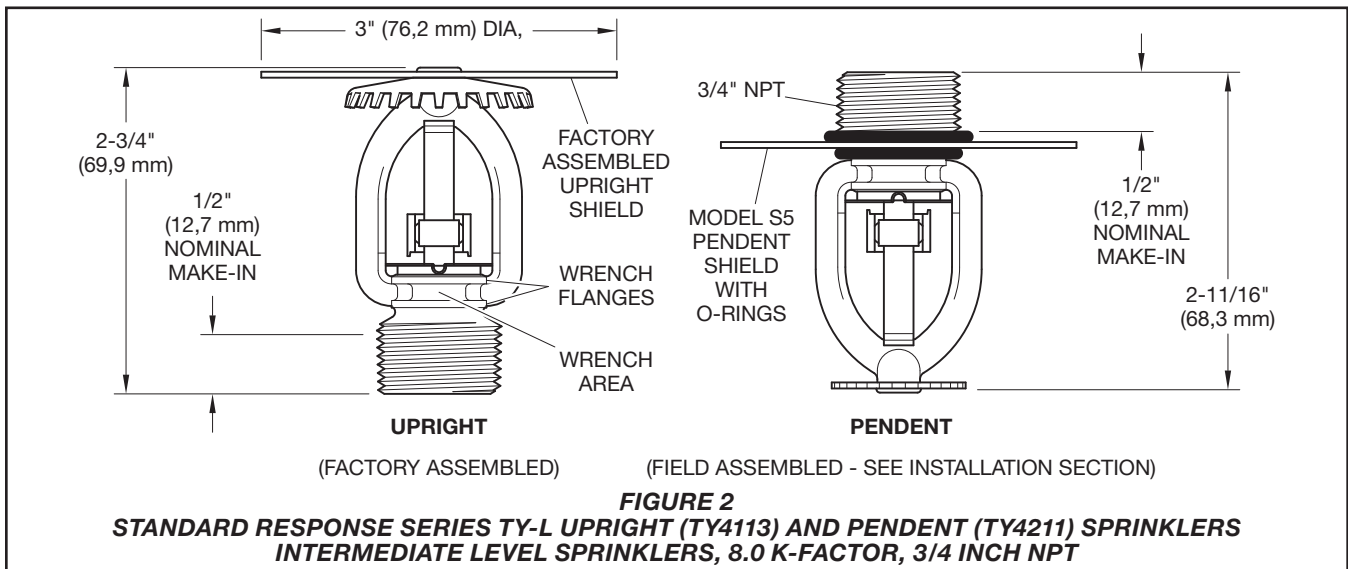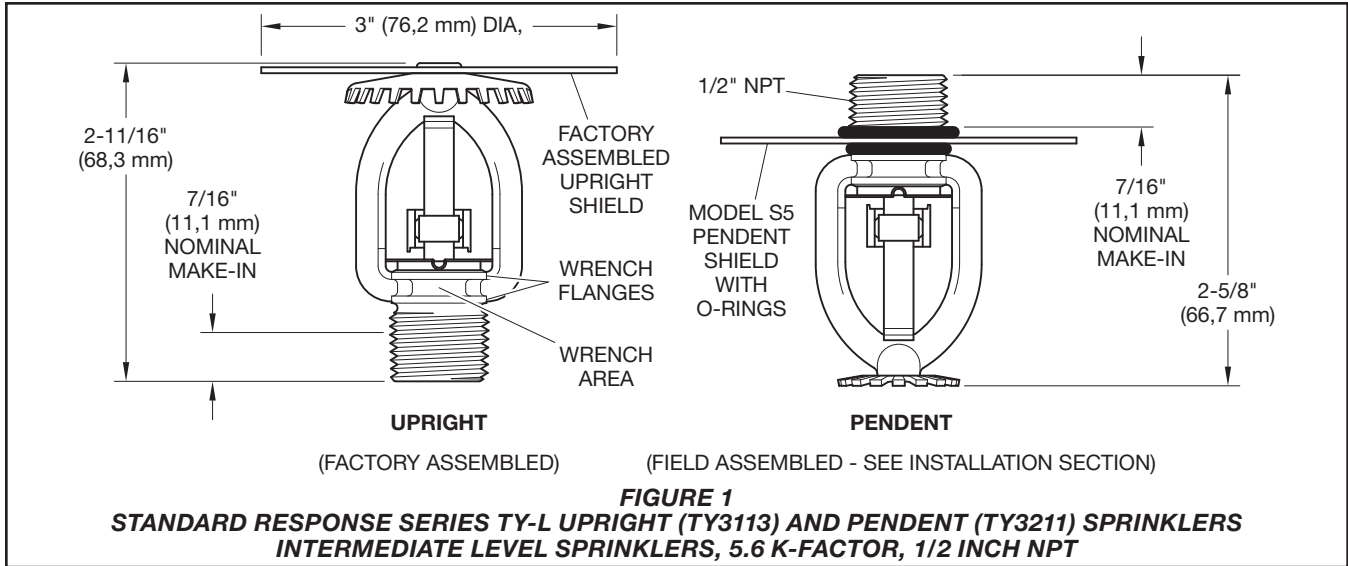

		SPRINKLER FINISH	
		K = 5.6 UPRIGHT TY3113 K = 5.6 PENDENT TY3211	K = 8.0 UPRIGHT TY4113 K = 8.0 PENDENT TY4211
TEMP. RATING	FRAME COLOR CODE	NATURAL BRASS	NATURAL BRASS
165°F (74°C)	UNPAINTED	1, 2, 3	
212°F (100°C)	WHITE		
280°F (138°C)	BLUE		

- NOTES**
- Listed by Underwriters Laboratory, Inc. (UL).
 - Listed by Underwriters Laboratory, Inc. for use in Canada (C-UL)
 - Approved by Factory Mutual Research Corporation.

TABLE A
LABORATORY LISTINGS AND APPROVALS

Operation

A copper tube sealed by two stainless steel balls holds a fusible alloy. When the rated temperature is reached, the alloy melts, the balls are forced toward each other releasing the tension mechanism, allowing the sprinkler to operate.

Design Criteria

The Series TY-L Pendent and Upright Intermediate Level Sprinklers are intended for fire protection systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency (e.g., UL Listing is based on the requirements of NFPA 13, and FM Approval is based on the requirements of FM Global's Loss Prevention Data Sheets).

Installation

The Series TY-L Sprinklers must be installed in accordance with this section.

NOTE: A leak-tight 1/2 inch NPT sprinkler joint should be obtained by applying a minimum-to-maximum torque of 7 to 14 ft.-lbs. (9,5 to 19,0 Nm). A leak tight 3/4 inch NPT sprinkler joint should be obtained by applying a minimum-to-maximum torque of 10 to 20 ft.-lbs. (13,4 to 26,8 Nm). Higher levels of torque may distort the sprinkler inlet and cause leakage or impairment of the sprinkler.

Upright Sprinklers

The Series TY-L Intermediate Level Upright Sprinklers must be installed in accordance with the following instructions.

Step 1. With pipe thread sealant applied to the pipe threads, hand tighten the sprinkler into the sprinkler fitting.

Step 2. Tighten the sprinkler into the sprinkler fitting using only the W-Type 9 Sprinkler Wrench (Ref. Figure 3). With reference to Figure 1 or 2, the W-Type 9 Sprinkler Wrench is to be applied to the wrenching area.

Pendent Sprinklers

The Series TY-L Intermediate Level Pendent Sprinklers must be installed in accordance with the following instructions.

Step 1. Roll one of the two required O-Rings over the sprinkler threads until it seats against the sprinkler wrenching area flange as shown in Figure 1 or 2, as applicable.

Step 2. Install the Shield over the sprinkler threads, and then roll the second O-Ring over the sprinkler threads until it is seated firmly against the Shield.

Step 3. With pipe thread sealant applied, hand tighten the sprinkler into the sprinkler fitting.

Step 4. Tighten the sprinkler into the sprinkler fitting using only the W-Type 9 Sprinkler Wrench (Ref. Figure 3). The wrench is to be applied to the sprinkler wrenching area shown in Figure 1 or 2, as applicable.

When installed correctly, the O-Rings will be slightly compressed and the Shield will be held firmly in place.

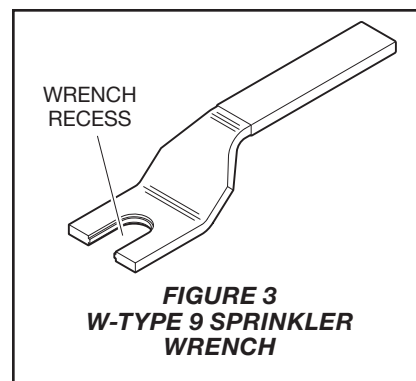


FIGURE 3
W-TYPE 9 SPRINKLER
WRENCH

Care and Maintenance

The Series TY-L Sprinklers must be maintained and serviced in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, permission to shut down the affected fire protection system must be obtained from the proper authorities and all personnel who may be affected by this action must be notified.



Sprinklers that are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated or otherwise altered after leaving the factory. Modified or over-heated sprinklers must be replaced.

Care must be exercised to avoid damage to the sprinklers before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the National Fire Protection Association (e.g., NFPA 25), in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or product manufacturer with any questions.

It is recommended that automatic sprinkler systems be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

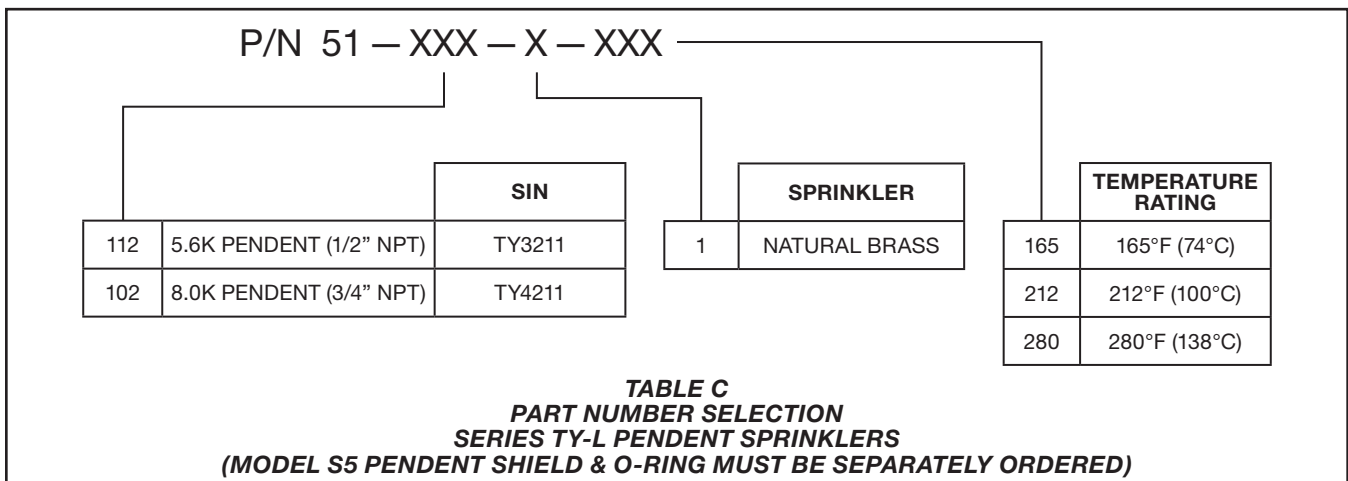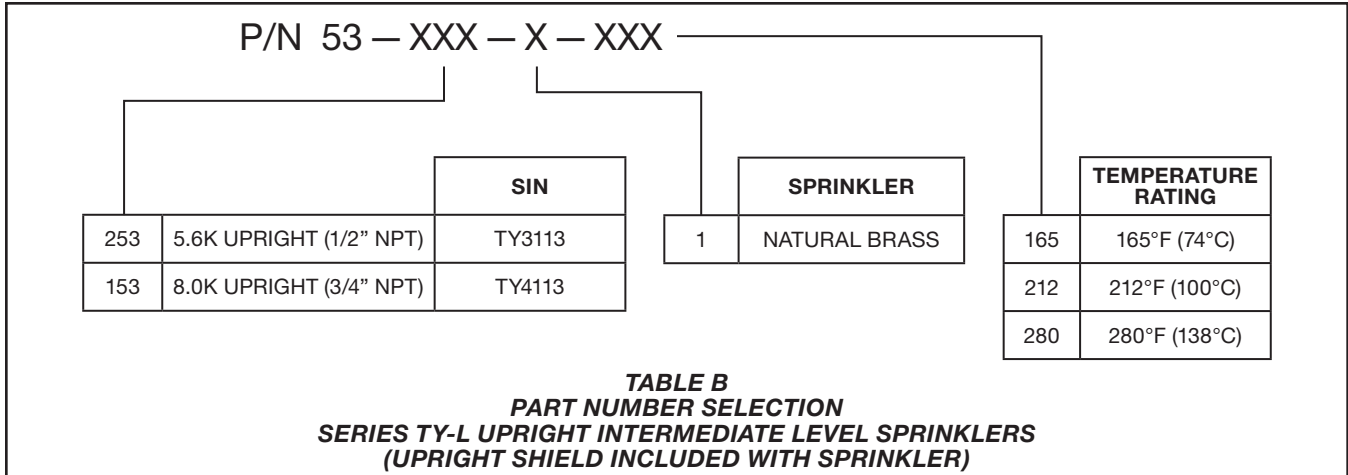

Limited Warranty

For warranty terms and conditions, visit www.tyco-fire.com.

Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and Part Number (P/N).

Upright Sprinkler Assemblies with Shield and NPT Thread Connections

Specify: (Specify Model/SIN), Standard Response, (specify K-factor), (specify temperature rating), Series TY-L Upright Intermediate Level Sprinklers with natural brass finish, P/N (specify from Table B)

Pendent Sprinkler Assemblies with (Shield Ordered Separately) and NPT Thread Connections

Specify: (Specify Model/SIN), Standard Response, (specify K-factor), (specify temperature rating), Series TY-L Pendent Sprinkler with natural brass finish, P/N (specify from Table C)

Model S5 Pendent Shield Package

Specify: S5 Pendent Shield Package (one shield / two O-Rings) for use with (specify 1/2" NPT or 3/4" NPT) Series TY-L Pendent Sprinklers, P/N (specify)

1/2" NPT56-015-6-802
 3/4" NPT56-015-6-803

Sprinkler Wrench

Specify: W-Type 9 Sprinkler Wrench, P/N 56-000-1-849